

Figure 1

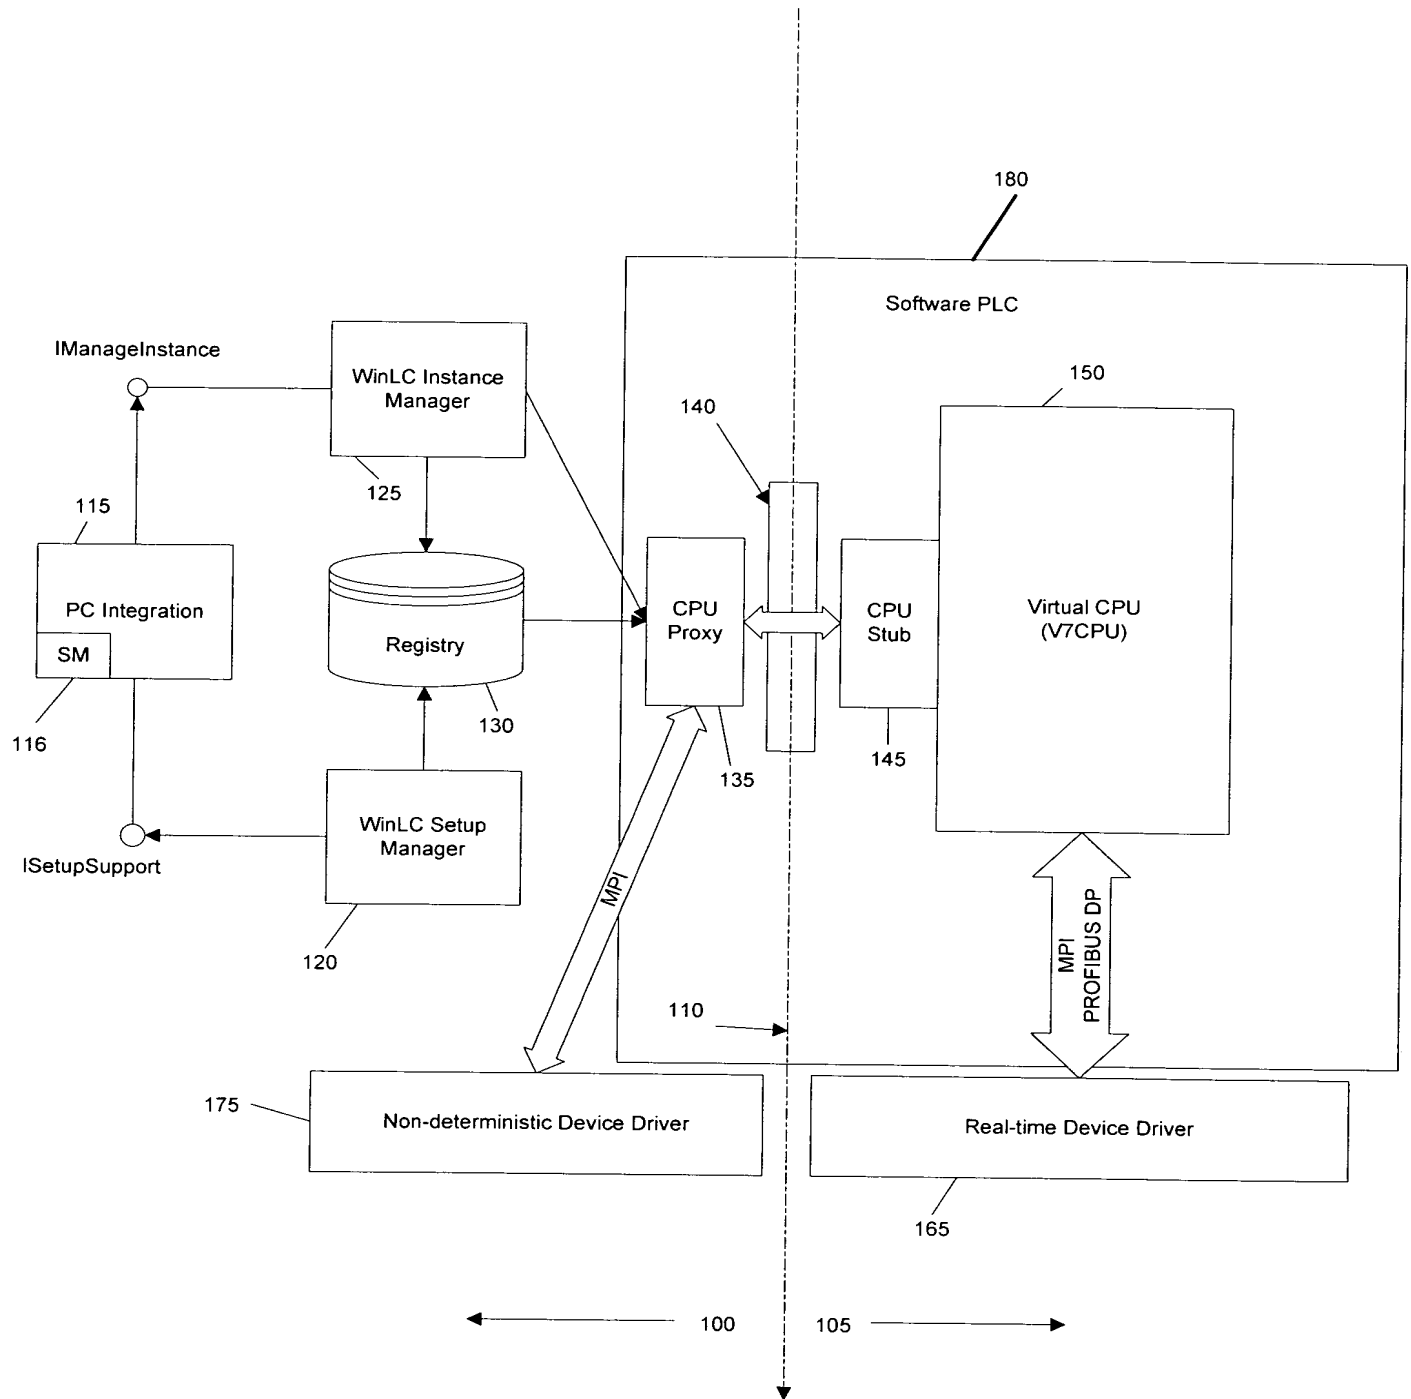


Figure 2

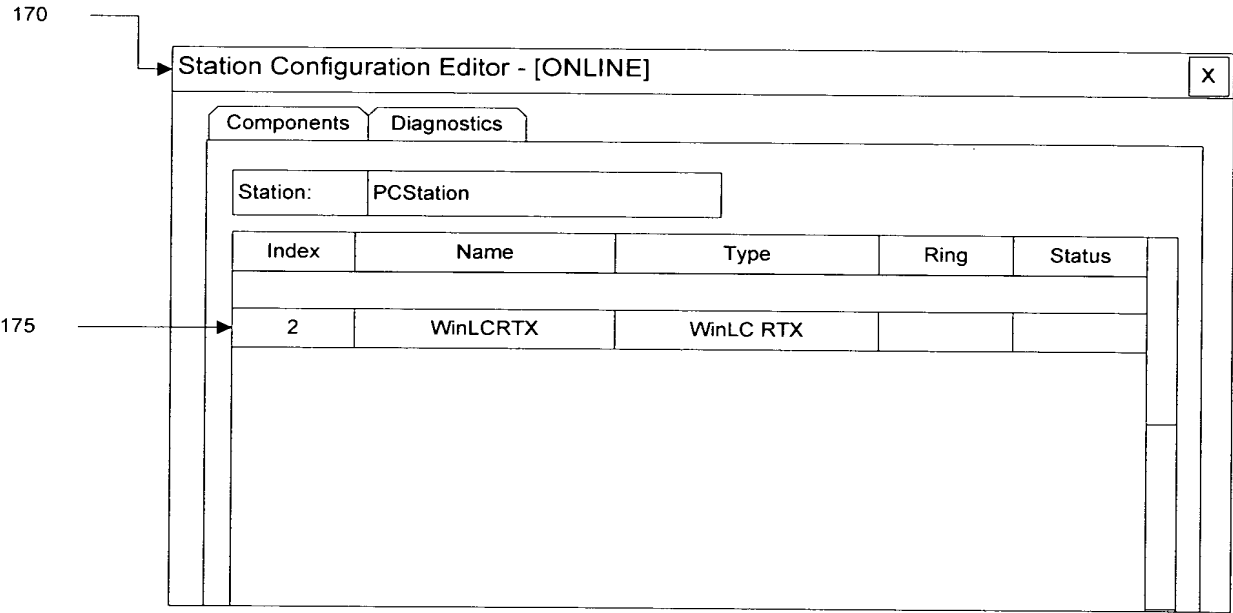


Figure 3

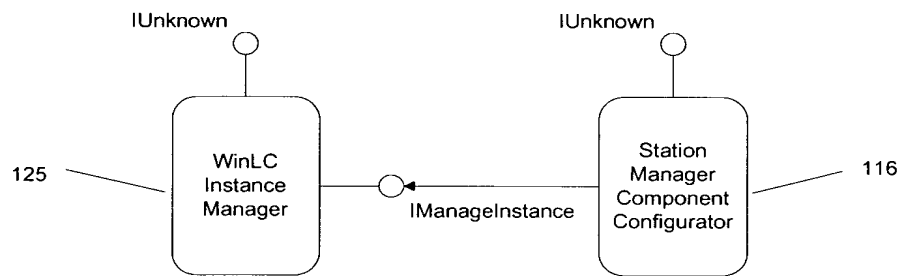


Figure 4

180

Station Configuration Editor - [ONLINE]

Components

Station:PCStation

Index	Name	Type	Ring	Status
2	WinLC	WinLC		
7	CP5613	CP5613, SW V5.0 SP5		

Figure 5A

180

Station Configuration Editor - [ONLINE]

Components

Station:PCStation

Index	Name	Type	Ring	Status
2	WinLC	WinLC		

Edit Component

Type:WinLC

Index:2

Name:WinLC

Parameter assig:

Properties

OK

Cancel

Help

Station Name...

Import XDB...

OK

Help

Figure 5B

180

WinLC Properties

X

SunModule

WinLC:WinLC

Index	Name	Type	Location	Ring
IF1				
IF2				
IF3				
IF4				

AddEditDeleteRing ONHelp

OK

Figure 5C

180

Station Manager CP Modules

X

Name	Type	Location	Configuration
CP5613 (Slot 1)	CP5613	PC Slot 1	PG/PC Interface

OK

Cancel

Figure 5D

WinLC Properties

X

SunModule

WinLC:WinLC

Index	Name	Type	Location	Ring
IF1	CP5613	CP5613	PC Slot 1	
IF2				
IF3				
IF4				

AddEditDeleteRing ONHelp

OK

Figure 5E

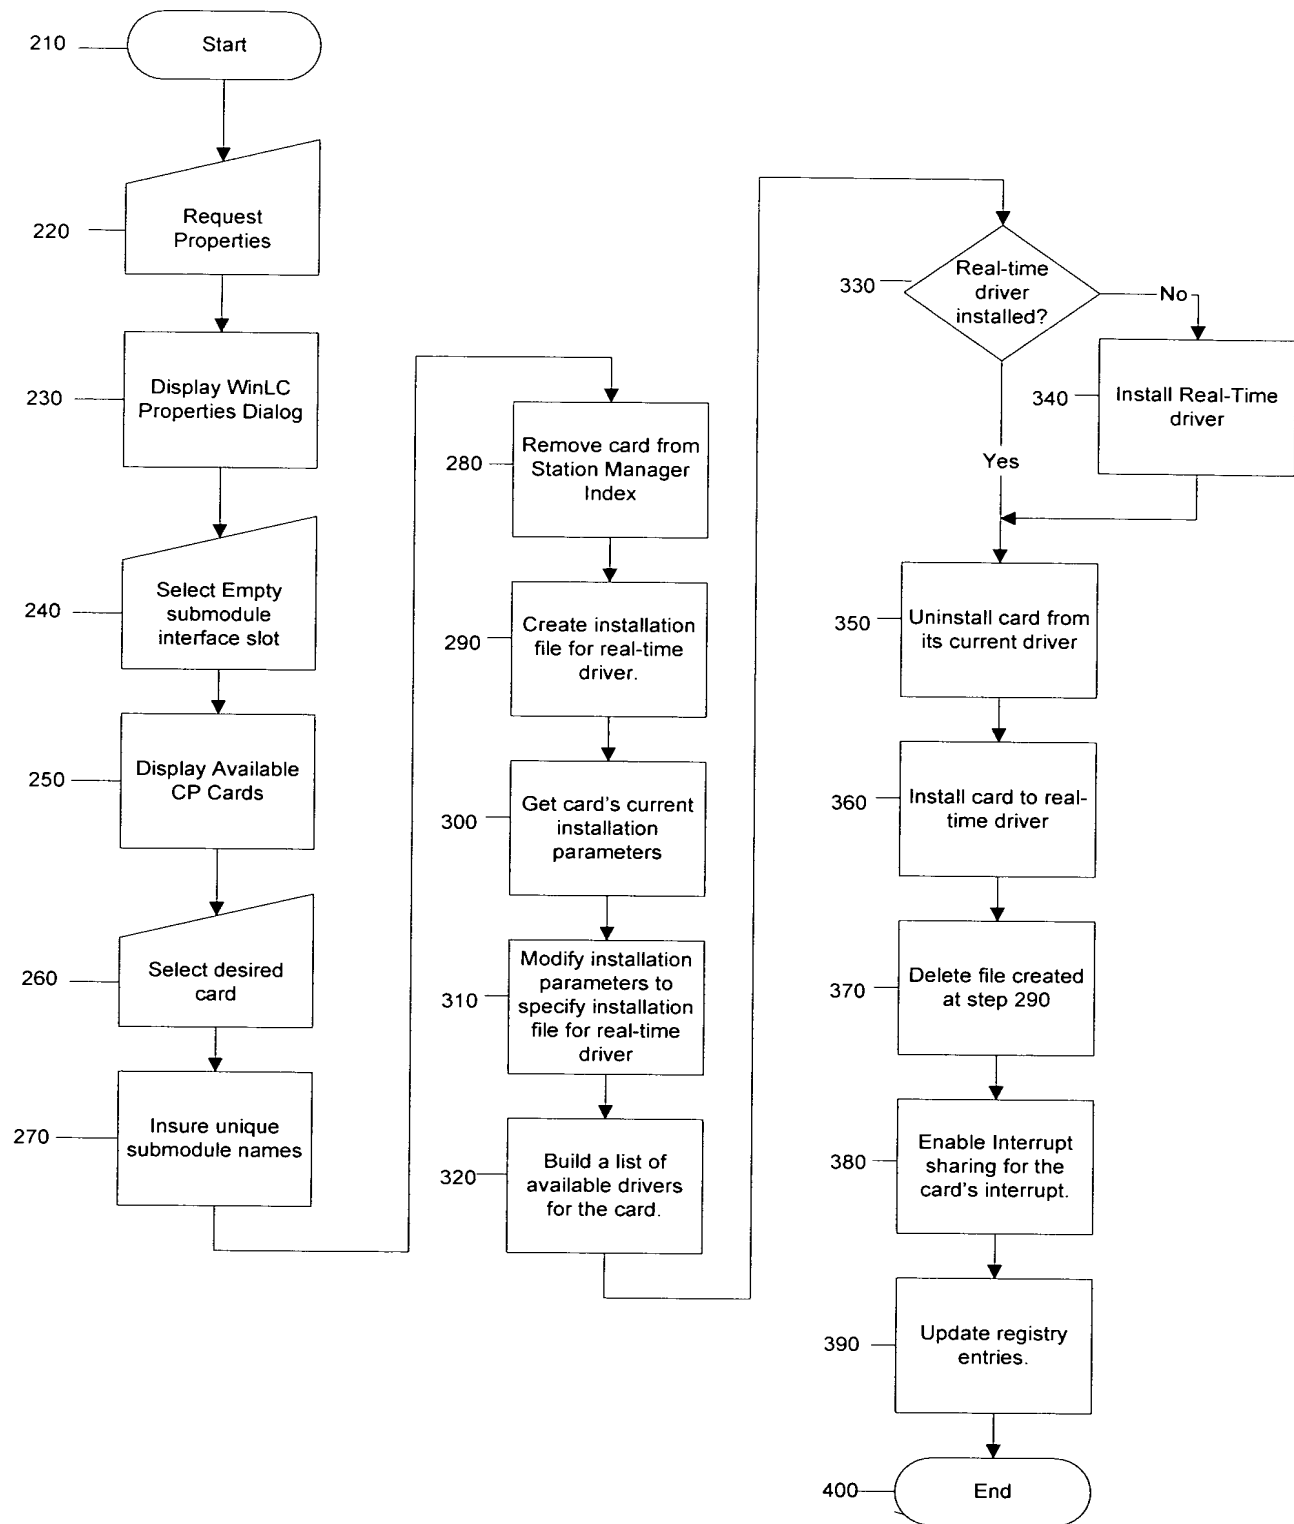


Figure 6